REVISIONS

Rev #	Date	BY:
1	10/18/16	J.P.
2	10/26/16	J.P.

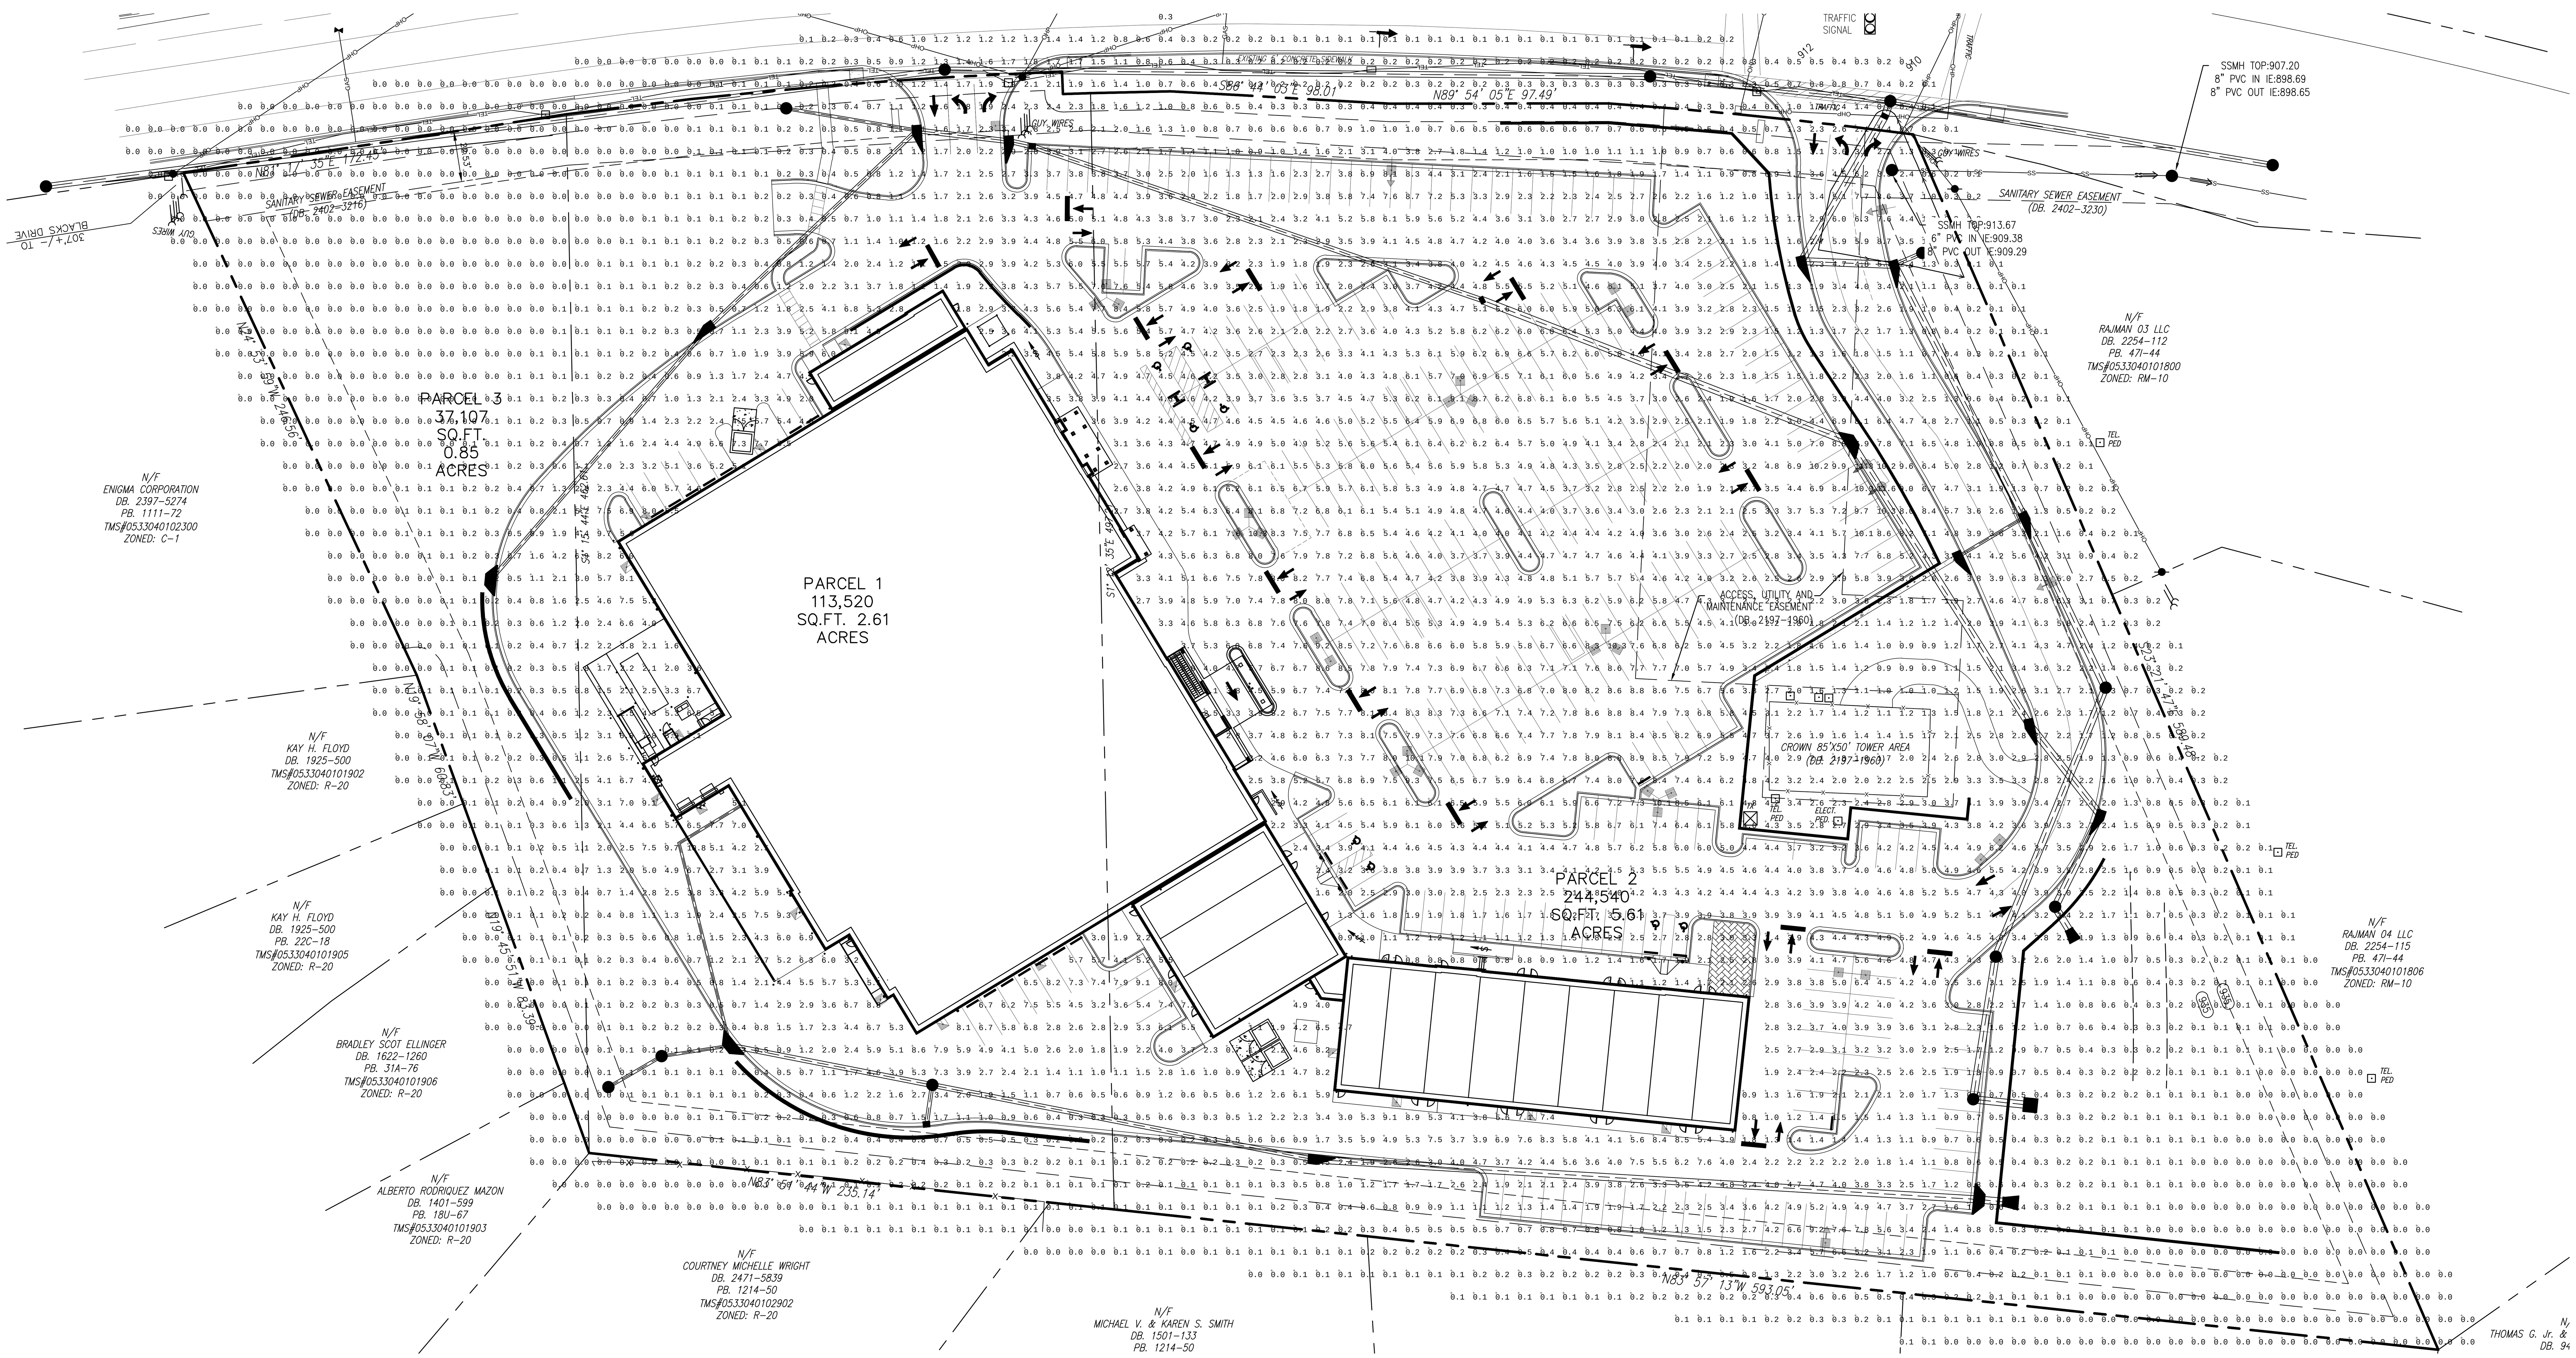

Calculation Summary								
Label	Units	Avg	Max	Min	Avg/Min	Max/Min	PtSpcLr	PtSpcTb
ENTRANCE DRIVE	Fc	3.66	8.7	0.7	5.23	12.43	10	10
LOWES FOOD FRONT SUMMARY	Fc	5.69	8.1	3.1	1.84	2.61		
MAIN PARKING	Fc	4.79	10.9	1.1	4.35	9.91		
SIDE AND REAR	Fc	3.25	10.8	0.2	16.25	54.00		

Luminaire Schedule

WLS13187 LOWE FOOD #269 GREENVILLE, SC PM: HOLLY PLEASE EMAIL US FOR PRICING AT WLS@WLSLIGHTING.COM

Symbol	Qty	Label	Lumens	LLF	Description	Lum. Watts
	6	A	N.A.	0.970	WLS-OSQ-L-A-5SH-T-57K 25' MOUNTING HEIGHT	171
	4	B	N.A.	0.970	WLS-OSQ-L-A-5SH-T-57K 25' MOUNTING HEIGHT	171
	1	C	N.A.	0.970	WLS-OSQ-L-A-5SH-T-57K 25' MOUNTING HEIGHT	171
	4	E	N.A.	0.970	WLS-OSQ-L-A-3ME-U-57K-BLS 25' MOUNTING HEIGHT	211.5
	16	F	N.A.	0.970	WLS-OSQ-M-A-4ME-J-57K 16' MOUNTING HEIGHT	168
	1	G	N.A.	0.970	(1) WLS-OSQ-L-A-NM-4ME-U-57K-RR & (1) WLS-OSQ-L-A-NM-4ME-U-57K-RL 25' MOUNTING HEIGHT	215

Based on the information provided, all dimensions and luminaire locations shown represent recommended positions. The engineer and/or architect must determine applicability of the layout to existing or future field conditions.

This lighting pattern represents illumination levels calculated from laboratory data taken under controlled conditions utilizing current industry standard lamp ratings in accordance with Illuminating Engineering Society approved methods. Actual performance of any manufacturer's luminaire may vary due to variation in electrical voltage, tolerance in lamps and other variable field conditions.

1919 WINDSOR PLACE
FORT WORTH, TX 76110
www.wlslighting.com

WLS LIGHTING SYSTEMS
Consider the Impact!

800-633-8711

SHEET 1 OF 1

BY: J.P.

PM:HOLLY

LOWES FOOD # 269 GREENVILLE, SC

scale: 1"=40'

DATE -9/30/16

WLS-13187